




*SEE PAGE C-34 FOR MAXIMUM SLOPE

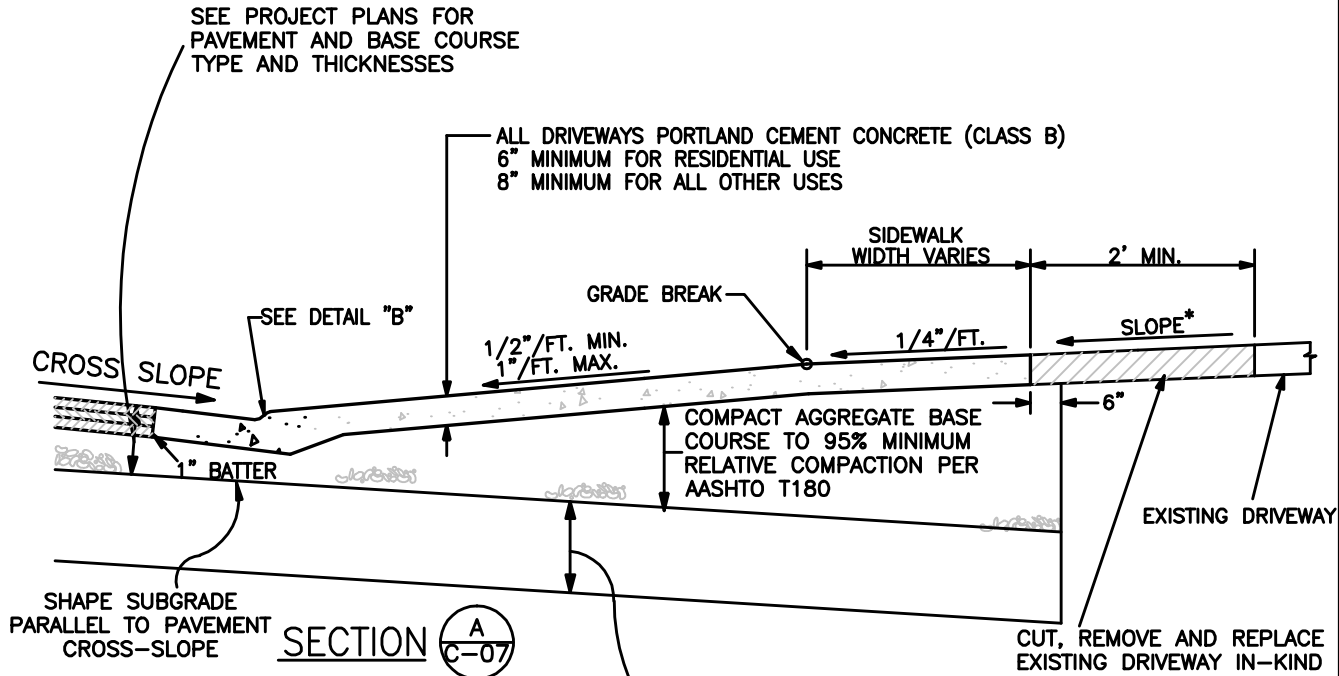

NOTE: CONCRETE AND AGGREGATE THICKNESS SHOWN ALSO APPLY TO MONOLITHIC C.G. & SW.
 12" MIN. SUBGRADE RECONDITIONING - SHALL INCLUDE REMOVAL, REPLACEMENT AND COMPACT SOIL TO 95% MINIMUM RELATIVE COMPACTION PER AASHTO T-99.

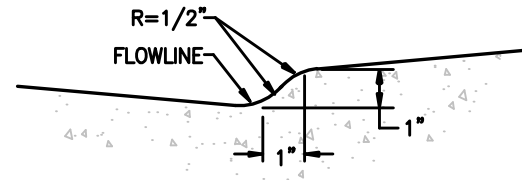

DETAIL "B"

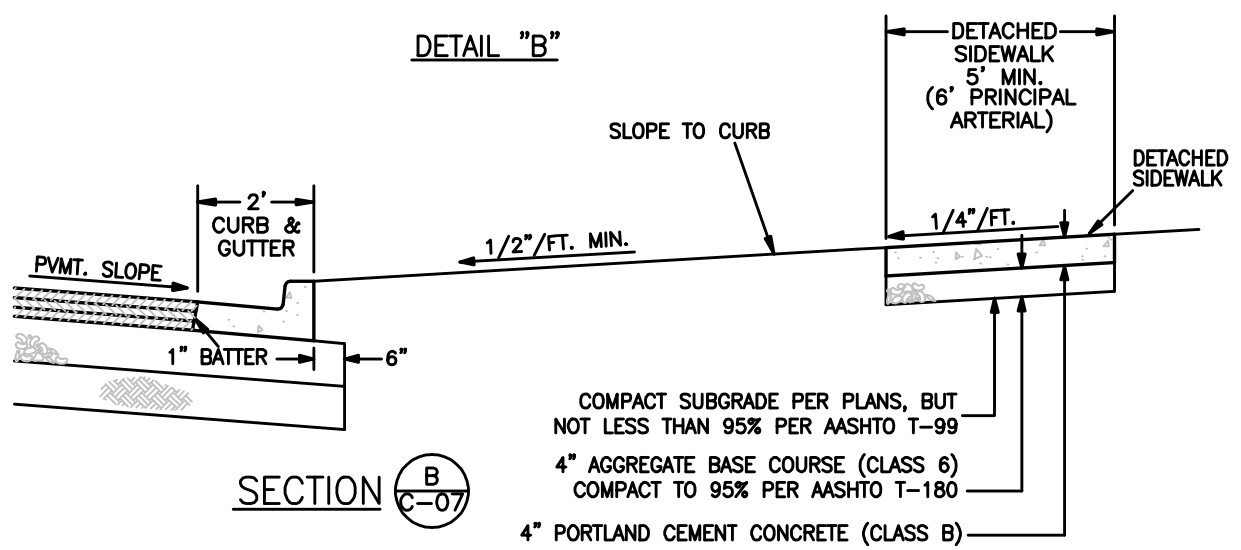

SIDEWALK MAY BE BELOW CURB ELEVATION AND/OR SLOPE AWAY FROM CURB WHERE APPROVED BY THE CITY ENGINEER.

DRIVEWAY SECTION A (DETACHED SW.) AND DRIVEWAY SECTION B (CURB, GUTTER AND DETACHED SW.)

DEPARTMENT OF PUBLIC WORKS AND PLANNING ENGINEERING DIVISION CITY OF GRAND JUNCTION, COLORADO	STANDARD CONCRETE DETAIL	APPROVED: <u>DN</u> REV: <u>FEB. 2006</u> DRAWN: <u>GM</u>	PAGE C-10
---	-----------------------------	--	--------------

N:\c:\net\c11\STANDARDS\STANDARD DRAWING DETAILS\2007-Concrete Details REV 5-10-07.dwg, C-10 (REV. 3-2007), 5/29/2007 3:20:56 PM