


* SEE PAGE C-34 FOR MAXIMUM SLOPE.

** CROSS SLOPE SHALL NOT EXCEED 1/4" /FT. WHEN LONGITUDINAL SLOPE OF GUTTER IS GREATER THAN 4%.


SEE PROJECT PLANS FOR PAVEMENT AND BASE COURSE TYPE AND THICKNESSES

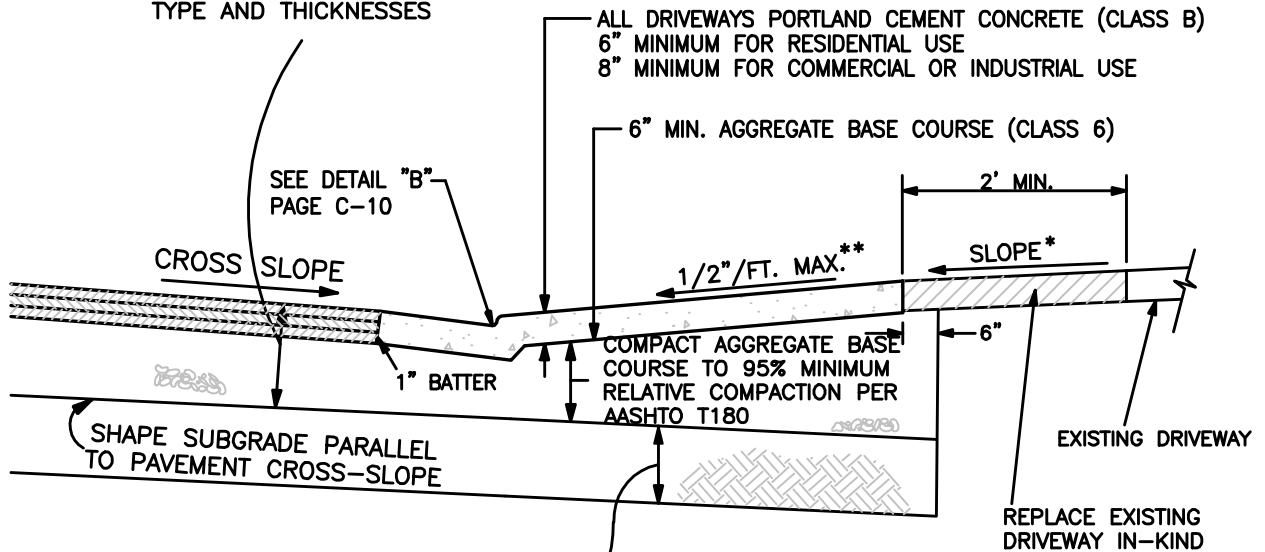

12" MIN. SUBGRADE RECONDITIONING - SHALL INCLUDE REMOVAL, REPLACEMENT AND COMPACT SOIL TO 95% MINIMUM RELATIVE COMPACTION PER AASHTO T-99.

SECTION C
C-08

SEE PROJECT PLANS FOR PAVEMENT AND BASE COURSE TYPE AND THICKNESSES

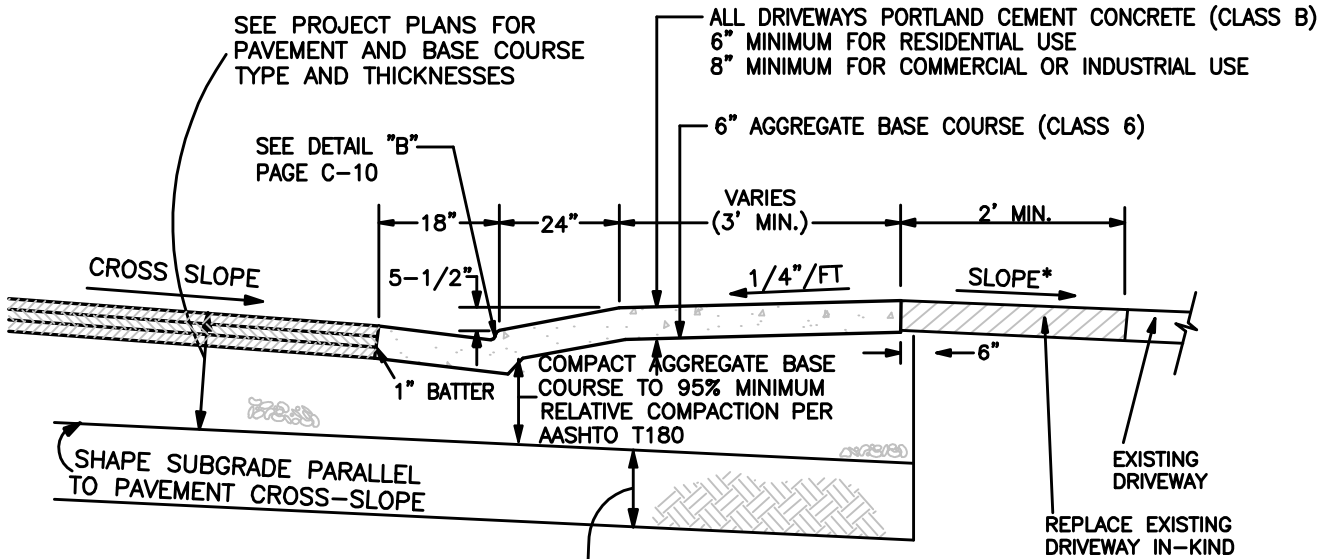

12" MIN. SUBGRADE RECONDITIONING - SHALL INCLUDE REMOVAL, REPLACEMENT AND COMPACT SOIL TO 95% MINIMUM RELATIVE COMPACTION PER AASHTO T-99.

SECTION D
C-09

DRIVEWAY SECTIONS C AND D (MONOLITHIC CURB, GUTTER AND SIDEWALK)

DEPARTMENT OF PUBLIC WORKS AND PLANNING
ENGINEERING DIVISION
CITY OF GRAND JUNCTION, COLORADO

STANDARD CONCRETE
DETAIL

APPROVED: DN
REV: FEB. 2006
DRAWN: CM

PAGE
C-11